

Summary Report

Serial Number 0004754637
Alarm **Triggered**

First Reading 08:34:27 2018-01-29
Last Reading 09:14:27 2018-01-31
Elapsed Time 2 days, 40 minutes
Total Readings 293
Logging Rate 10 minutes

Minimum 0.7°C 15:54:27 2018-01-29
Maximum 21.7°C 09:14:27 2018-01-31
Average 14.8°C
Standard Deviation 5.9°C
MKT 14.68°C (dH83.14472)

High Alarm: 25.0°C

First Triggered N/A
Occurrences 0
Time in Alarm 0 seconds
Longest Alarm 0 seconds

Low Alarm: 2.0°C


First Triggered 15:24:27 2018-01-29
Occurrences 1
Time in Alarm 2 hours, 0 seconds
Longest Alarm 2 hours, 0 seconds

Zone 1: 8.0 to 15.0°C for 3h, 0s

Time Triggered 14:54:27 2018-01-29
Total Time in Zone 9 hours, 20 minutes

Zone 2: 8.0 to 15.0°C for 1d, 0s

Time Triggered N/A
Total Time in Zone 9 hours, 20 minutes

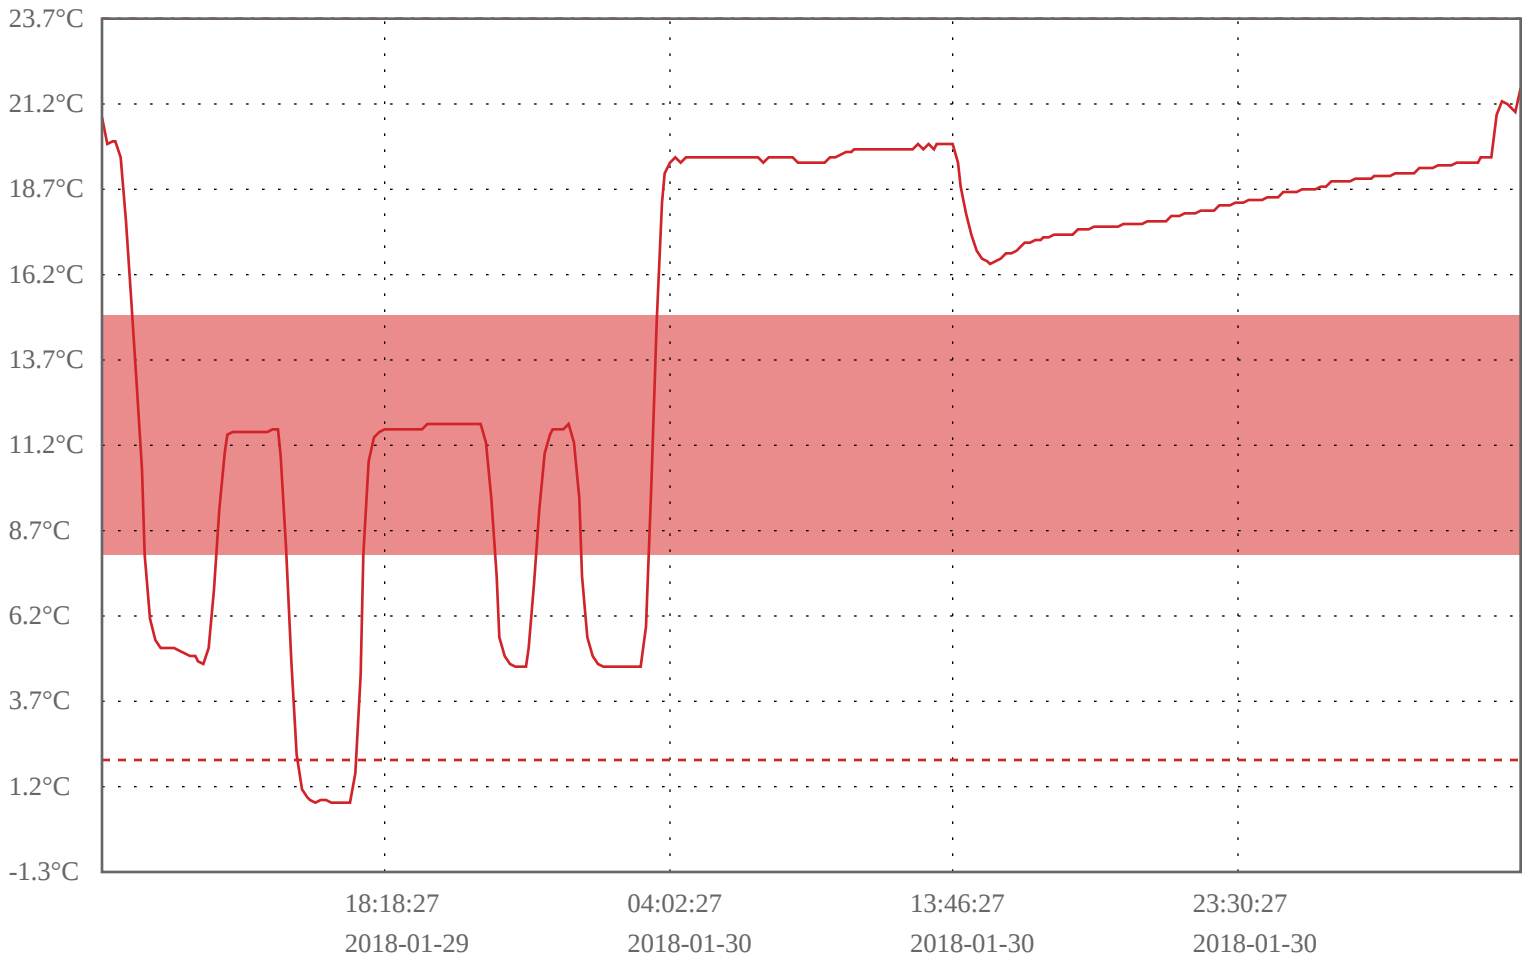

----- Low Alarm

..... High Alarm

Zone 1

Zone 2