

PRODUCT DESCRIPTION

Web Sensors P8552, P8652 and P8653 with Ethernet connection are designed to measure temperature and relative humidity of the air. The devices are equipped with two connectors for connection of the temperature and humidity external probes and three binary inputs for two states signals. The dry contact or two-state voltage signal can be connect to the binary input. The first binary input of the sensor P8653 is intended for the flood detector LD-81 connection. The devices are powered from an external power supply adapter. Web Sensors P8652, P8653 supports also Power over Ethernet (PoE).

Measured values can be read and then processed using an Ethernet connection. The following formats of Ethernet communication are supported: www pages with user-design possibility, Modbus TCP protocol, SNMPv1 protocol, SOAP protocol and XML. The instrument may send also a warning message if the measured value exceeds adjusted limit. The messages can be sent up to 3 e-mail addresses or to Syslog server and can be sent by SNMP Trap too. The alarm states are also displayed on the websites. The device setup can be made by the *TSensor* software (see www.cometsystem.com) and using the www interface.

Type	Measured value	Construction	PoE
P8552	T + RH + BIN	Two connectors for external probes and terminal block for three binary inputs	no
P8652	T + RH + BIN	Two connectors for external probes and terminal block for three binary inputs	yes
P8653	T + RH + BIN	Two connectors for external probes and terminal block for LD-81 detector and two binary inputs	yes

T...temperature, BIN... binary input, RH...relative humidity

INSTALLATION AND OPERATION

The devices are designed for wall mounting with two screws or bolts. Pay attention to the location of the device and probe. Incorrect choice of working position could adversely affect accuracy and long-term stability of measured values. The Web Sensor with attached DSRH/C or DST/C probe install always vertically with the sensor cover downwards. Devices don't require any special operation and maintenance. We recommend you periodic calibration for measurement accuracy validation.

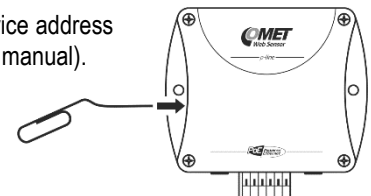
DEVICE SETUP

Contact your network administrator to obtain necessary information for the device connection into the network (IP address, default gateway, subnet mask) and check if there is no IP address conflict when you connect the device into network for the first time. IP address of each device is set by manufacturer to **192.168.1.213**. Install the latest version of *TSensor* to your PC, connect the Ethernet cable and connect the power supply (see "Device connection procedure" on the other side of this data sheet).

Run the configuration software *TSensor*. Set the „Ethernet“ communication interface and press „Find Device“ button. According to MAC address (see device label) select device for configuration and by „Change IP Address“ button set new address according to network administrator instructions. Gateway IP address may not be entered if you want to use the device only in local network. After changing of IP address the device is restarted and new IP address is assigned. Restart of the device takes about 10 seconds.

The device setup can be made by the web interface. Main page will be shown when you insert device address into address bar of your web browser. Access to device setup is possible via tile **Settings** (see user manual).

To restore the Web Sensor to the **factory default settings** use the button inside the device. Turn of the power supply and press the button (see picture). Turn on the power supply and keep the button pressed for 10 sec.



ERROR STATES AND TROUBLESHOOTING

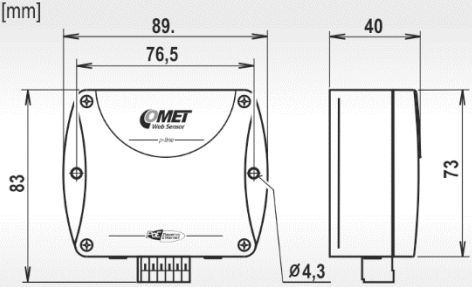



Device continuously checks its state during operation and if an error appears, the device sends the error message. The detailed description of the error messages is given in the user manual Chapter "Troubleshooting".

SAFETY INSTRUCTIONS



- Don't connect or disconnect thermometers while power supply is on.
- Installation, electrical connection and commissioning should be performed by qualified personnel only.
- Use the power adapter according to technical specifications and approved according to relevant standards only.
- The external probe cable should be located as far as possible from potential interference sources.
- If it is necessary connect the device to the Internet, properly configured firewall must be used.
- The device should not be used for applications, where malfunction could cause to injury or damage to property.
- Devices contain electronic components, it needs to liquidate them according to legal requirements.
- **To supplement the information** provided in this data sheet, use the manuals and other documentations which are available at www.cometsystem.com



Technical specifications

Device type	P8552	P8652	P8653
Supply voltage - coaxial connector 5.1 x 2.1mm, (+) pole in the middle	4.9 to 6.1 Vdc	4.9 to 6.1 Vdc	4.9 to 6.1 Vdc
Power over Ethernet according to IEEE 802.3af, PD Class 0	no	yes	yes
Power consumption	approximately 1W	approximately 1W	approximately 1W
Temperature measuring range	according to the probe *	according to the probe *	according to the probe *
Accuracy of temperature measurement	according to the probe *	according to the probe *	according to the probe *
Relative humidity measuring range	according to the probe *	according to the probe *	according to the probe *
Accuracy of relative humidity measurement	according to the probe *	according to the probe *	according to the probe *
Temperature operating range (humidity 0 to 100%RH, no condensation)	-30 to +80°C	-20 to +60°C	-20 to +60°C
Protection class	IP30	IP30	IP30
Recommended calibration interval	according to the probe *	according to the probe *	according to the probe *
Electromagnetic compatibility according to	EN 61326-1	EN 61326-1	EN 61326-1
Mounting position	any position **	any position **	any position **
Weight	140 g	145 g	145 g (LD-81 ~ 60 g)
Dimensions [mm]			
			


* see the specification of external probes
 ** the device with attached DSRH/C or DST/C probe install always vertically with the sensor cover downwards

Binary inputs

- 3 binary inputs without galvanic isolation
- the type of input (*Dry contact* / *Voltage input*) is selectable at device setup

Dry contact 		Terminal voltage with open contact	3.3 V
		Current through closed contact	< 0.1 mA
		Resistance of the contact	< 5 kΩ
Napětiový vstup 		Voltage level for „LOW“	< 1.0 V
		Voltage level for „HIGH“	> 2.5 V
		Internal resistance of the voltage source	< 2 kΩ
		Input voltage range	0 to 30 V
		Reverse polarity protection	yes

Flood detector LD-81 (P8653 only)



P8552, P8652 - input terminal

IN1	IN2	IN3
GND	GND	GND
BIN1	BIN2	BIN3

binary input: BIN1 BIN2 BIN3

P8653 - input terminal

RED	IN2	IN3
BLACK	GND	GND
LD-81	BIN2	BIN3

binary input: BIN1 BIN2 BIN3

* the detector cable can't be extended

External probes

Probe type	DSTG8/C	DSTGL40/C	DSTR162/C	DSRHxx+	DSRH/C	DST/C
Temperature measuring range	-50 to +100°C	-30 to +80°C		0 to +50°C	0 to +50°C	-30 to +80°C
	± 0.5°C (-10 to +85°C)	± 0.5°C (-10 to +80°C)		± 0.5°C	± 0.5°C	± 0.5°C (-10 to +80°C)
Accuracy of temperature measurement	± 2.0°C (-50 to -10°C)	± 2.0°C (below -10°C)				± 2.0°C (below -10°C)
	± 2.0°C (+85 to +100°C)					
Relative humidity measuring range	—	—		10 to 90 %RH *	10 to 90 %RH *	—
Accuracy of humidity measurement	—	—		± 3.5 %RH **	± 3.5 %RH **	—
Temperature operating range	-50 to +125°C	-30 to +80°C		-30 to +80°C	-30 to +80°C	-30 to +80°C
Humidity operating range (no condensation)	0 to 100 %RH	0 to 100 %RH		0 to 100 %RH	0 to 100 %RH	0 to 100 %RH
Protection class	IP67	IP67		IP40	IP20	IP20
Recommended calibration interval	2 years	2 years		1 year	1 year	2 years
Cable length	1, 2, 5, 10 m	1, 2, 5, 10 m		1, 2, 5 m	—	—
Mounting position	any position	any position		any position	sensor cover downwards	sensor cover downwards
Dimensions of the sensor [mm]	Ø5.7 x 40	Ø5.7 x 40 Ø10 x 25		Ø18 x 90	Ø14 x 100	Ø14 x 100

* the relative humidity measuring range is limited at temperatures below 0°C and above 50°C, see manual for probe

** from 10 to 90%RH at temperature 25°C

Device connection procedure

